
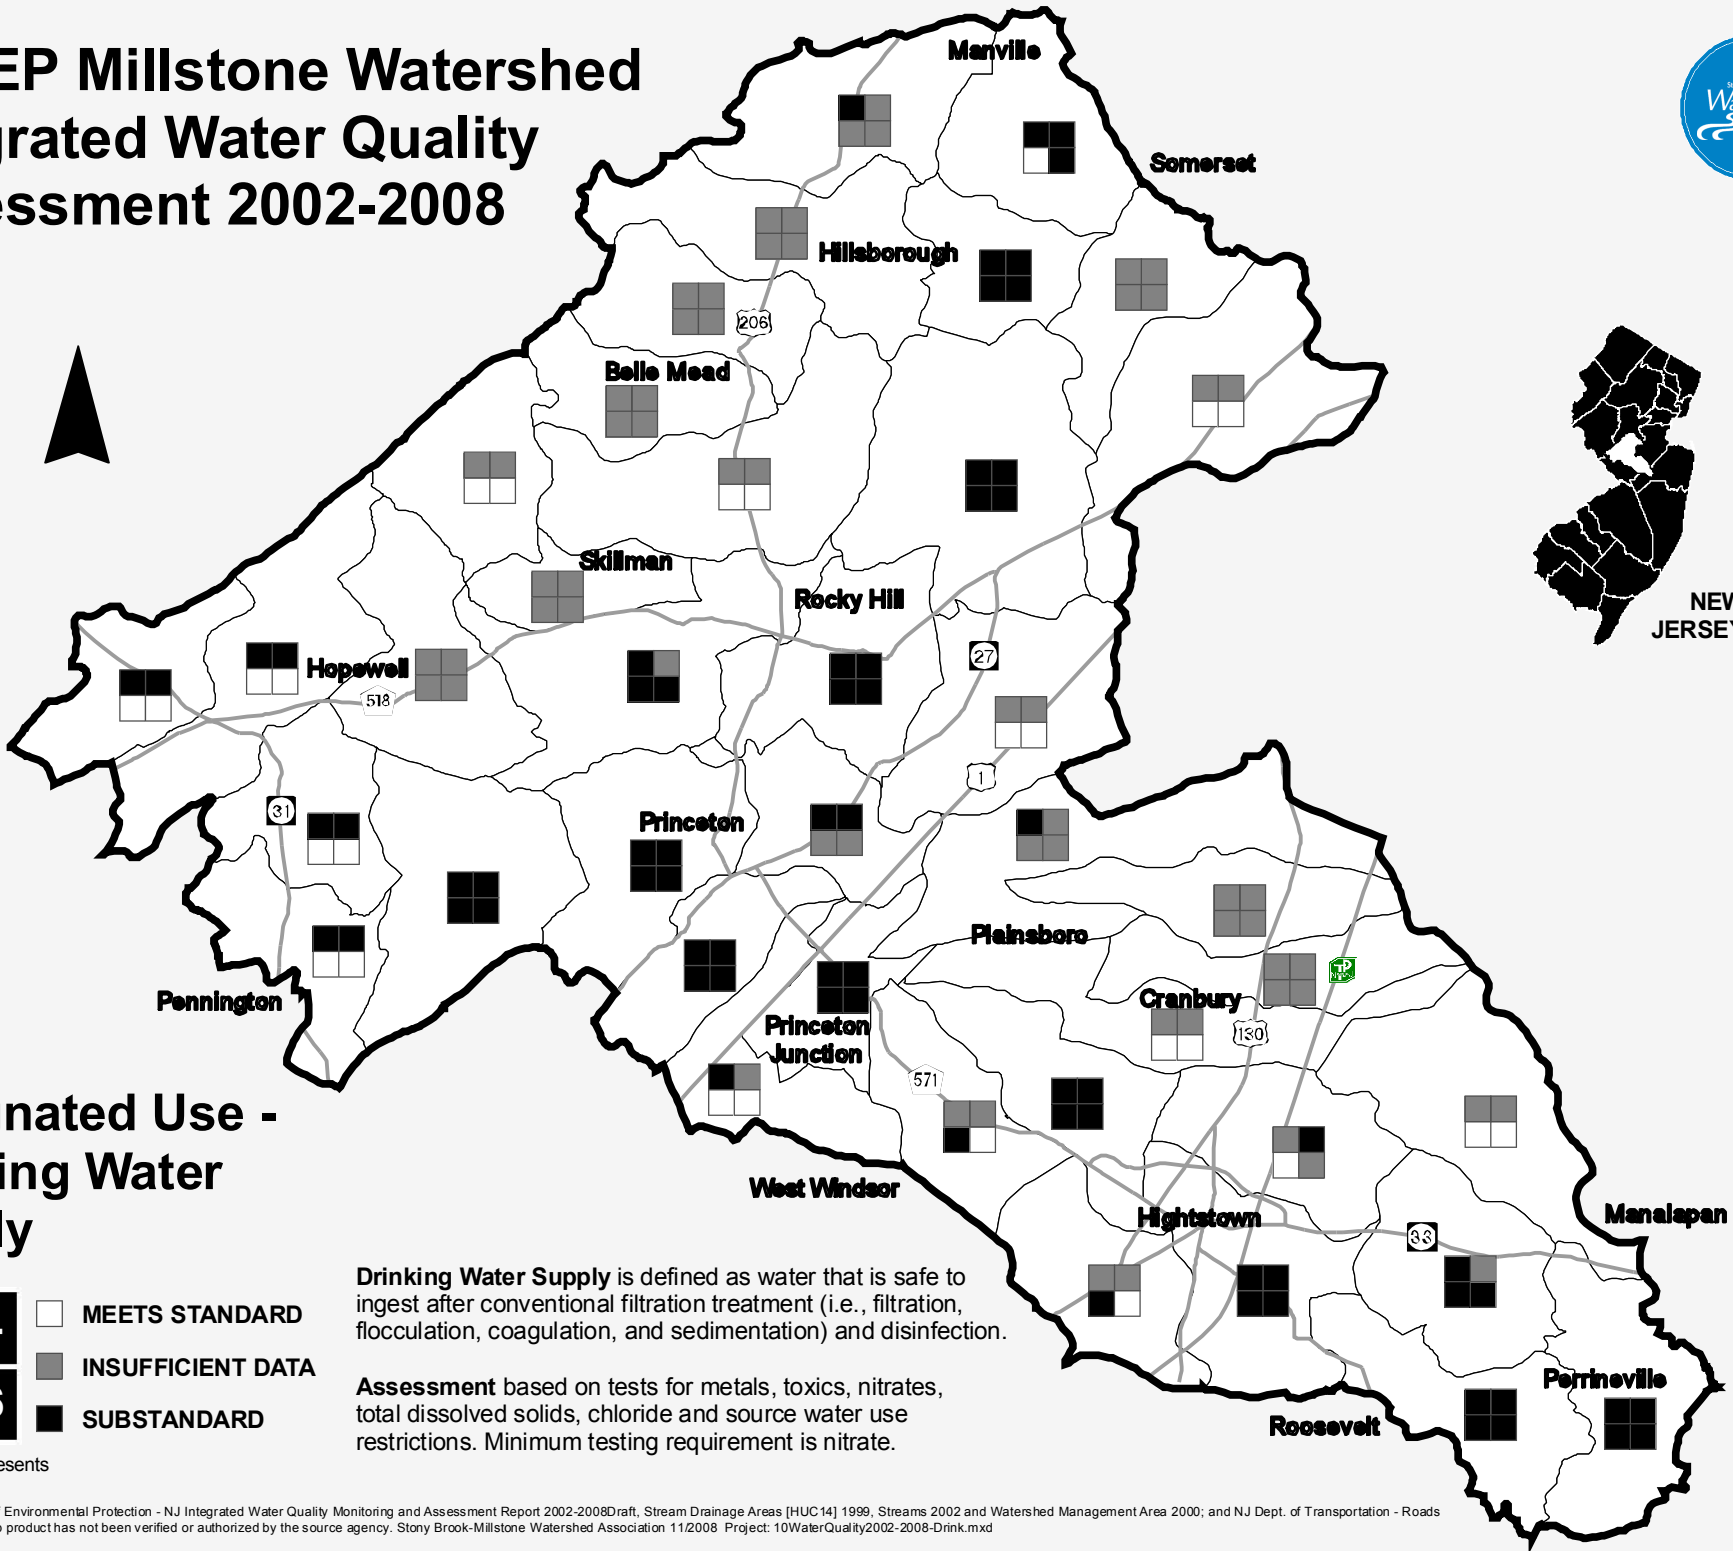


NJDEP Millstone Watershed Integrated Water Quality Assessment 2002-2008

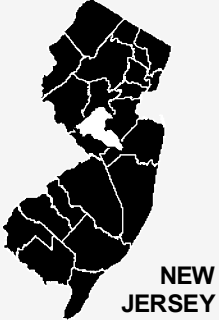

Designated Use - Drinking Water Supply

02	04	☐	MEETS STANDARD
08	06	■	SUBSTANDARD

Each block represents a reporting year.

Drinking Water Supply is defined as water that is safe to ingest after conventional filtration treatment (i.e., filtration, flocculation, coagulation, and sedimentation) and disinfection.

Assessment based on tests for metals, toxics, nitrates, total dissolved solids, chloride and source water use restrictions. Minimum testing requirement is nitrate.